


ooobob 005
65000 273 GW

n'3

上上上上

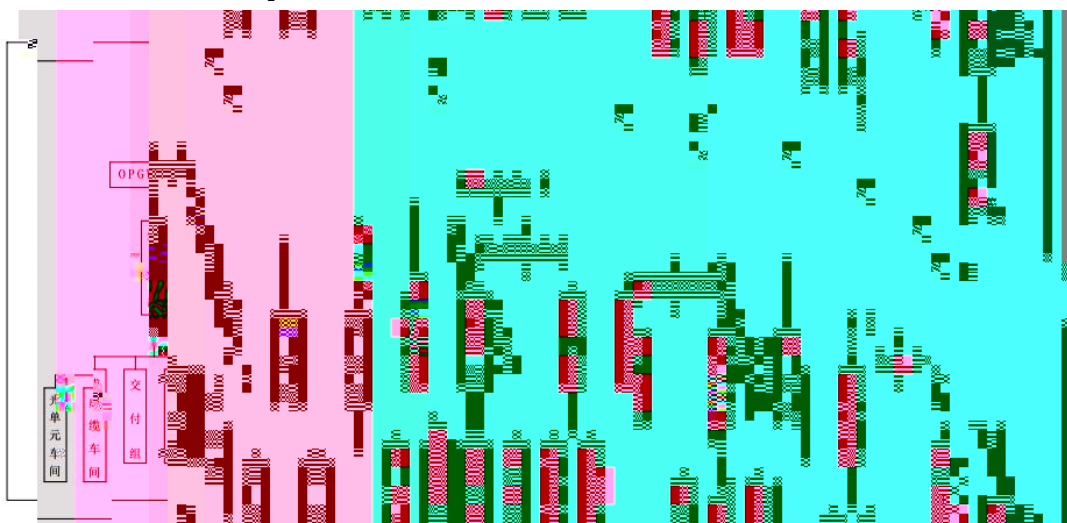

4.1

4.2



2

4.3

1	IEEE 1138-2021	IEEE Standard for Testing and Performance for Optical Ground Wire (OPGW) for Use on Electric Utility Power Lines OPGW	
2	IEEE 1595-2022	IEEE Standard for Testing and Performance for Optical Phase Conductor (OPPC) for Use on Electrical Utility Power Lines ----- OPPC	
3	IEC	1-404	-

60794-1-404-2022-0

H4

2

IEC

1-220

4

60794-1-404-2022

F20

5

IEEE 1591.1-2023

IEEE Standard for Testing and Performance of Hardware for
Optical Ground Wire (OPGW)

6

Q/GDW 761-2012

OPGW

7

CSN EN 60794-4-10

4-10

8

GBT 17937-2024

9

DL/T 832-2016

10

DL/T 1613-2016

11

DL/T 1601-2016

12

DL/T 1733-2017

13

YB/T 4682-2018

14

T/CEC 186-2018

4.5



"

"

"

"

AAA

2024

"

AA

"

6.1

I SO 14001

I SO 45001

2024

6.2

72L, 2.5tCO2e

8%

1 HF3

4

10362.96kWh

6.4

" "

CSR

CSR

CSR

"

£

2

∇

f

Σ

σ

€



7.1

"

"

8.1

100%

8.2

8.3



"

"

1

400

800

2000

"

"

2

3

"

"

4

"

"

8.4

8.5

8.6

EO

9.1




				65dB			100%
				55dB			
				100%			

9.2

(1)



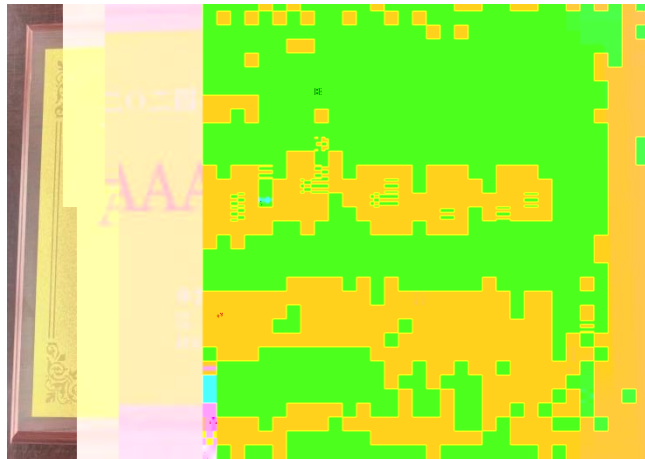

2024 4 ,

330kV

CPGW

2024 " 9.6"

" "

